

Resolution 18-112

RESOLUTION AUTHORIZING THE ISSUANCE OF A PUBLIC NOTICE  
PRIOR TO RENEWAL OF AN INDUSTRIAL SEWER CONNECTION PERMIT FOR

**LAKELAND BUS LINES, INC  
425 E. BLACKWELL STREET  
TOWNSHIP OF ROCKAWAY, NEW JERSEY**

**BE IT RESOLVED BY THE ROCKAWAY VALLEY REGIONAL SEWERAGE  
AUTHORITY (RVRSA) AS FOLLOWS:**

The Executive Director, JoAnn Mondisini, is hereby authorized to issue a public notice of the commencement of the 30-day public comment period, in accordance with N.J.A.C. 7:14A-15.10 and N.J.A.C. 7:14A-15.11, prior to consideration of an Industrial Sewer Connection Permit Renewal for Lakeland Bus Lines, 425 E. Blackwell Street, Township of Rockaway, NJ.

The proposed form of Industrial Sewer Connection Permit is marked Schedule "A," attached hereto and made a part hereof, a copy of which is also on file at the offices of RVRSA. The terms and conditions proposed include renewal of existing terms and conditions and updating of effluent limitations consistent with local limits study dated November 2014, last revised December 2016, including April 14, 2017 Addendum, approved by NJDEP on April 24, 2017. (See attached Fact Sheet).

I hereby certify that this Resolution was adopted at a meeting of the Rockaway Valley Regional Authority held on November 8, 2018.

On motion of Glenn Corbett

Second by Michael Guadagno


And a Roll Call Vote as Follows:

Yeas: (8) Andes, Cegelka, Corbett, Guadagno, Isselin, Lowell, Rossi, Schorno

Nays: (0) None

Abstain: (0) None

Absent: (2) Recchia and Vincitore

  
Michael Guadagno  
Board Secretary



**FACT SHEET**  
**Lakeland Bus Lines, Inc.**

This fact sheet sets forth the principal facts and the significant factual, legal, and policy considerations examined during preparation of the draft permit.

**PERMIT ACTION:** Renewal Industrial Sewer Connection Permit  
Effective Date: 12/1/2018 Expiration Date: 11/30/2021

**PERMITEE NAME AND ADDRESS:** Lakeland Bus Lines, Inc.  
P.O. Box 898  
Dover, NJ 07802-0898

**FACILITY NAME AND ADDRESS:** Lakeland Bus Lines, Inc.  
425 E. Blackwell Street  
Dover, NJ 07802-0898

**FACILITY CONTACT INFORMATION:** Donald Mazzarisi  
Operations Manager  
Phone No.: (973) 366-0600 ext. 618  
Cell No.: (973) 366-3145  
Email: [dmazz@lakelandbus.com](mailto:dmazz@lakelandbus.com)

Bill Murray  
Maintenance Supervisor

**RECEIVING LOCAL AGENCY:** Rockaway Valley Regional Sewerage Authority

**RECEIVING COLLECTION SYSTEM:** Local collection system owned and operated by the Township of Rockaway.

**DESCRIPTION OF FACILITY OPERATIONS:**

Lakeland Bus Lines provides transportation (bus line) service and maintenance and washing of commuter buses. Lakeland Bus Lines' SIC code is 7542. This facility is classified as Industrial User of Concern, discharging approximately 6,500 GPD (monthly average) of wastewater generated from this facility. The wastewater is being pretreated prior to discharge. The pretreatment device consists of an oil/water separator.

**DESCRIPTION OF DISCHARGE LOCATION(S) (see attached Figure 1):**

**Name:** 001  
**Latitude:** 40° 52' 59.43" N  
**Longitude:** 74° 32' 14.82" W  
**Description:** After Oil & Water Separator



### SUMMARY OF PERMIT CONDITIONS (see attached Table 1):

The following pollutants are regulated: BOD<sub>5</sub>, CBOD<sub>5</sub>, Total Suspended Solids (TSS), Total Dissolved Solids (TDS), pH, Oil & Grease (HEM), Total Petroleum Hydrocarbon (TPHC), Phosphorus, Ammonia-Nitrogen (NH<sub>3</sub>-N), Chromium (Cr), Copper (Cu), Lead (Pb), Molybdenum (Mo), Nickel (Ni), Selenium (Se), Zinc (Zn), and flow.

The basis for the limitations established is summarized in the local limits evaluation report titled RVRSA Local Limit Study, dated November 2014, last revised December 2016, including April 14, 2017 Addendum; approved by the NJDEP on April 24, 2017, and approved by the RVRSA board on August 10, 2017 and on December 14, 2017.

Below is a summary of key aspects of this renewal application.

1. *Flow*: Flow limitation has been carried over from the previous permit.
2. *Parameters of Concern*: None
3. *Other Parameters*: The following parameters limitations have been updated or have been added as per the local limits study dated, November 2014, last revised December 2016, including April 14, 2017 Addendum; approved by the NJDEP on April 24, 2017, and approved by the RVRSA board on August 10, 2017 and on December 14, 2017. **Limitation updated**: CBOD<sub>5</sub>, BOD<sub>5</sub>, Total Suspended Solids (TSS), Ammonia-Nitrogen (NH<sub>3</sub>-N), Oil & Grease (HEM), Copper, Lead, Nickel, and Zinc. **Parameters added**: TPHC, Molybdenum, and Selenium. **Parameter deleted**: Silver.

The following parameters are not required to be sampled/analyzed due to historical results of being "non-detect" and/or not a concern: Arsenic, Cadmium, Cyanide, Mercury, and Phenols.

### VARIANCES OR ALTERNATIVES TO PERMIT CONDITIONS:

N/A

### REGULATIONS APPLICABLE TO THIS PERMIT ACTION:

This permit is issued in accordance with N.J.S.A 58:10A-6f, N.J.A.C. 7:14A-19.8, and 40 CFR Part 403.8. Requirements for the contents of this Fact Sheet are in accordance with N.J.A.C. 7:14A-15.8.

### INDUSTRIAL PRETREATMENT PROGRAM CONTACT PERSON:

Additional information concerning this permit may be obtained from Natalie Pisarcik, RVRSA IPP Coordinator, at 973-263-1555, ext. 213.



**TABLE – 1: DISCHARGE LIMITATIONS**

**LAKELAND BUS LINES**

Sample Location: After Oil & Water Separator

Parameter	Daily Max. Limit	Mo. Avg. Limit.	Sample Frequency	Sample-Type
Flow	Report	6,500 GPD (4)	Continuous	Metered
BOD <sub>5</sub>	Report		Quarterly	Composite
CBOD <sub>5</sub>	500 mg/L (1) (2)		Quarterly	Composite
TSS	500 mg/L (1) (2)		Quarterly	Composite
TDS	Report		Quarterly	Composite
pH	5.5 - 9.5 SU (1) (3)		Quarterly	Grab
O&G,HEM	350 mg/L (1)		Quarterly	Grab
TPHC	150 mg/L (1)	100 mg/L (1)	Quarterly	Grab
Phosphorus	Report		Quarterly	Composite
NH <sub>3</sub> -N	80 mg/L (1) (2)		Quarterly	Composite
Chromium	1.3 mg/L (1)		Annually	Composite
Copper	1.7 mg/L (1)		Annually	Composite
Lead	1.0 mg/L (1)		Annually	Composite
Molybdenum	0.3 mg/L (1)		Annually	Composite
Nickel	0.8 mg/L (1)		Annually	Composite
Selenium	0.2 mg/L (1)		Annually	Composite
Zinc	2.1 mg/L (1)		Annually	Composite

Notes:

- (1) Discharge limits are based upon the RVRSA local limits.
- (2) CBOD<sub>5</sub> or TSS concentration exceeding 250 mg/l and NH<sub>3</sub>-N concentration exceeding 40 mg/L are subject to the Surcharge for Wastewaters of Excessive Strength as per Section 8B of this ISCP. Permittee may not discharge over the CBOD<sub>5</sub> limit of 500 mg/L, the TSS limit of 500 mg/L, or the NH<sub>3</sub>-N limit of 80 mg/L unless a variance has been issued by the RVRSA providing therefore. Discharges greater than the above stated limitations will be considered a permit violation and subject to applicable enforcement actions.
- (3) The pH sample shall be analyzed by a NJDEP certified lab, within 15 minutes of collection of the sample.
- (4) Monthly average flow of not more than 6,500 gallons per day (GPD).



Additional Notes:

The Monthly Report is due and shall be received by the RVRSA office on or before the 21<sup>st</sup> day of the month following the sampling month, or next business day (if date shall fall on a weekend and/or holiday). If no pollutant sample is collected or analyzed during a month, then the monthly report shall include at least flow data.

Parameters shall be tested according to monitoring frequency and submitted in a monthly Self Monitoring Report (SMR). All SMR's submitted must comply and contain the signatory requirement as required under 40 CFR § 403.6 (a)(2)(ii) and it must be signed by a responsible corporate officer as required under 40 CFR § 430.12(l).

Each composite sample shall be a representative composite of the regulated discharge, e.g. 24 – hour composite sample for 24 – hour operation/discharge and for batch discharge(s), a manual composite over the period of the batch discharge(s).

“Quarterly” sampling shall occur during the following months:

- 2019: February, May, August, November
- 2020: March, June, September, December
- 2021: January, April, July, October
- 2022: February, May, August, November

The “Annually” sample period shall correspond to the January – December calendar year.


Copies of manifests for process wastewater trucked offsite for disposal shall be made available for review by our offices.



**FIGURE 1: Sampling Location**

**LAKELAND BUS LINES**

SAMPLING LOCATION (Discharge location: 001)

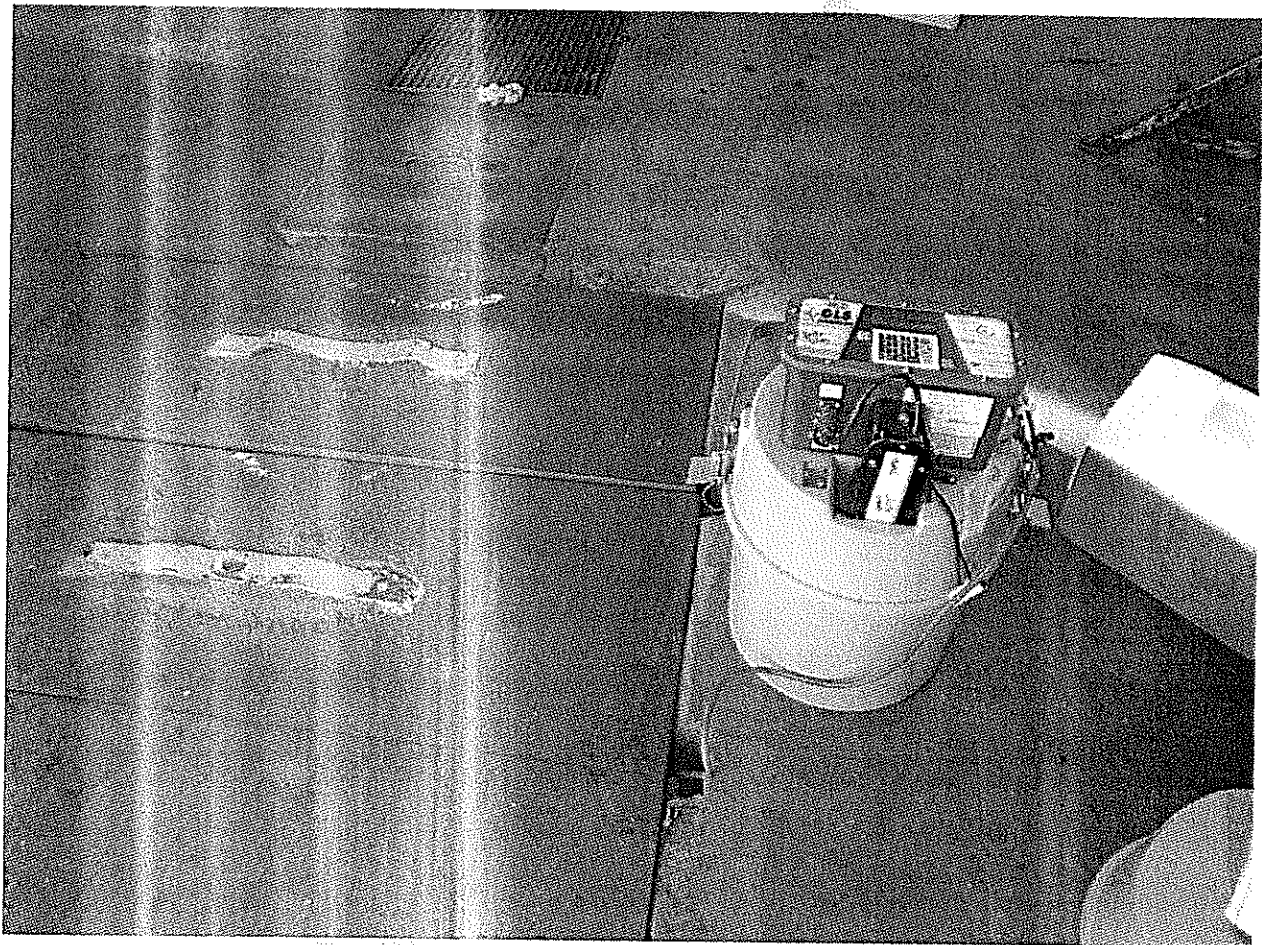

**ROCKAWAY VALLEY REGIONAL SEWERAGE AUTHORITY**  
RD #1, 99 GREENBANK ROAD  
BOONTON, NEW JERSEY 07005-9602

**PUBLIC NOTICE**  
**ISSUANCE OF AN INDUSTRIAL SEWER CONNECTION PERMIT RENEWAL**

Notice is hereby given that the Rockaway Valley Regional Sewerage Authority (RVRSA) proposes to issue a three (3) year renewal of their Industrial Sewer Connection Permit (ISCP), in accordance with N.J.A.C. 7:14A and by authority of the Water Pollution Control Act at N.J.S.A. 58:10A-1 et seq., for wastewater discharge into and treatment by the RVRSA to applicant:

**LAKELAND BUS LINES**  
**425 E. BLACKWELL STREET**  
**TOWNSHIP OF ROCKAWAY, NEW JERSEY**

The primary activity conducted at applicant's facility is providing transportation (bus line) service, and maintenance and washing of commuter buses. A draft Industrial Sewer Connection Permit renewal has been prepared based upon the administrative record, which is available for viewing or copying. Interested parties may obtain a copy of the draft Industrial Sewer Connection Permit for a nominal charge, or electronically for no charge. To view the permit at the RVRSA call Natalie Pisarcik, Pretreatment Coordinator at 973-263-1555 extension 213 or email at nataliep@rvrsa.org, between the hours of 7:30 A.M. and 3:30 P.M., Monday through Friday.

Written comments or a request that the RVRSA hold a non-adversarial public hearing on the draft document must be submitted in writing by certified mail (return receipt requested), or by other means which provides verification of the date of delivery to the RVRSA, attention Natalie Pisarcik, Pretreatment Coordinator, Rockaway Valley Regional Sewerage Authority, RD #1, 99 Greenbank Road, Boonton, New Jersey 07005-9602, by the close of the comment period, which closes thirty (30) calendar days after publication of this notice in the *Daily Record*.

All persons, including the applicant, who believe that any condition of this draft document is inappropriate or that the RVRSA's decision to issue this draft is inappropriate, must raise all reasonably ascertainable arguments and factual grounds supporting their position, including all supporting materials, during the public comment period. RVRSA will respond to all significant and timely comments upon issuance of the final permit decision. The applicant and each person who has submitted written comments or requested a copy of the notice will receive notice of the RVRSA's permit decision.

JoAnn Mondsini  
Executive Director